



02 公司简介


资质荣誉




完全满足国标GB14287.1-2014《电气火灾监控系统》的要求；







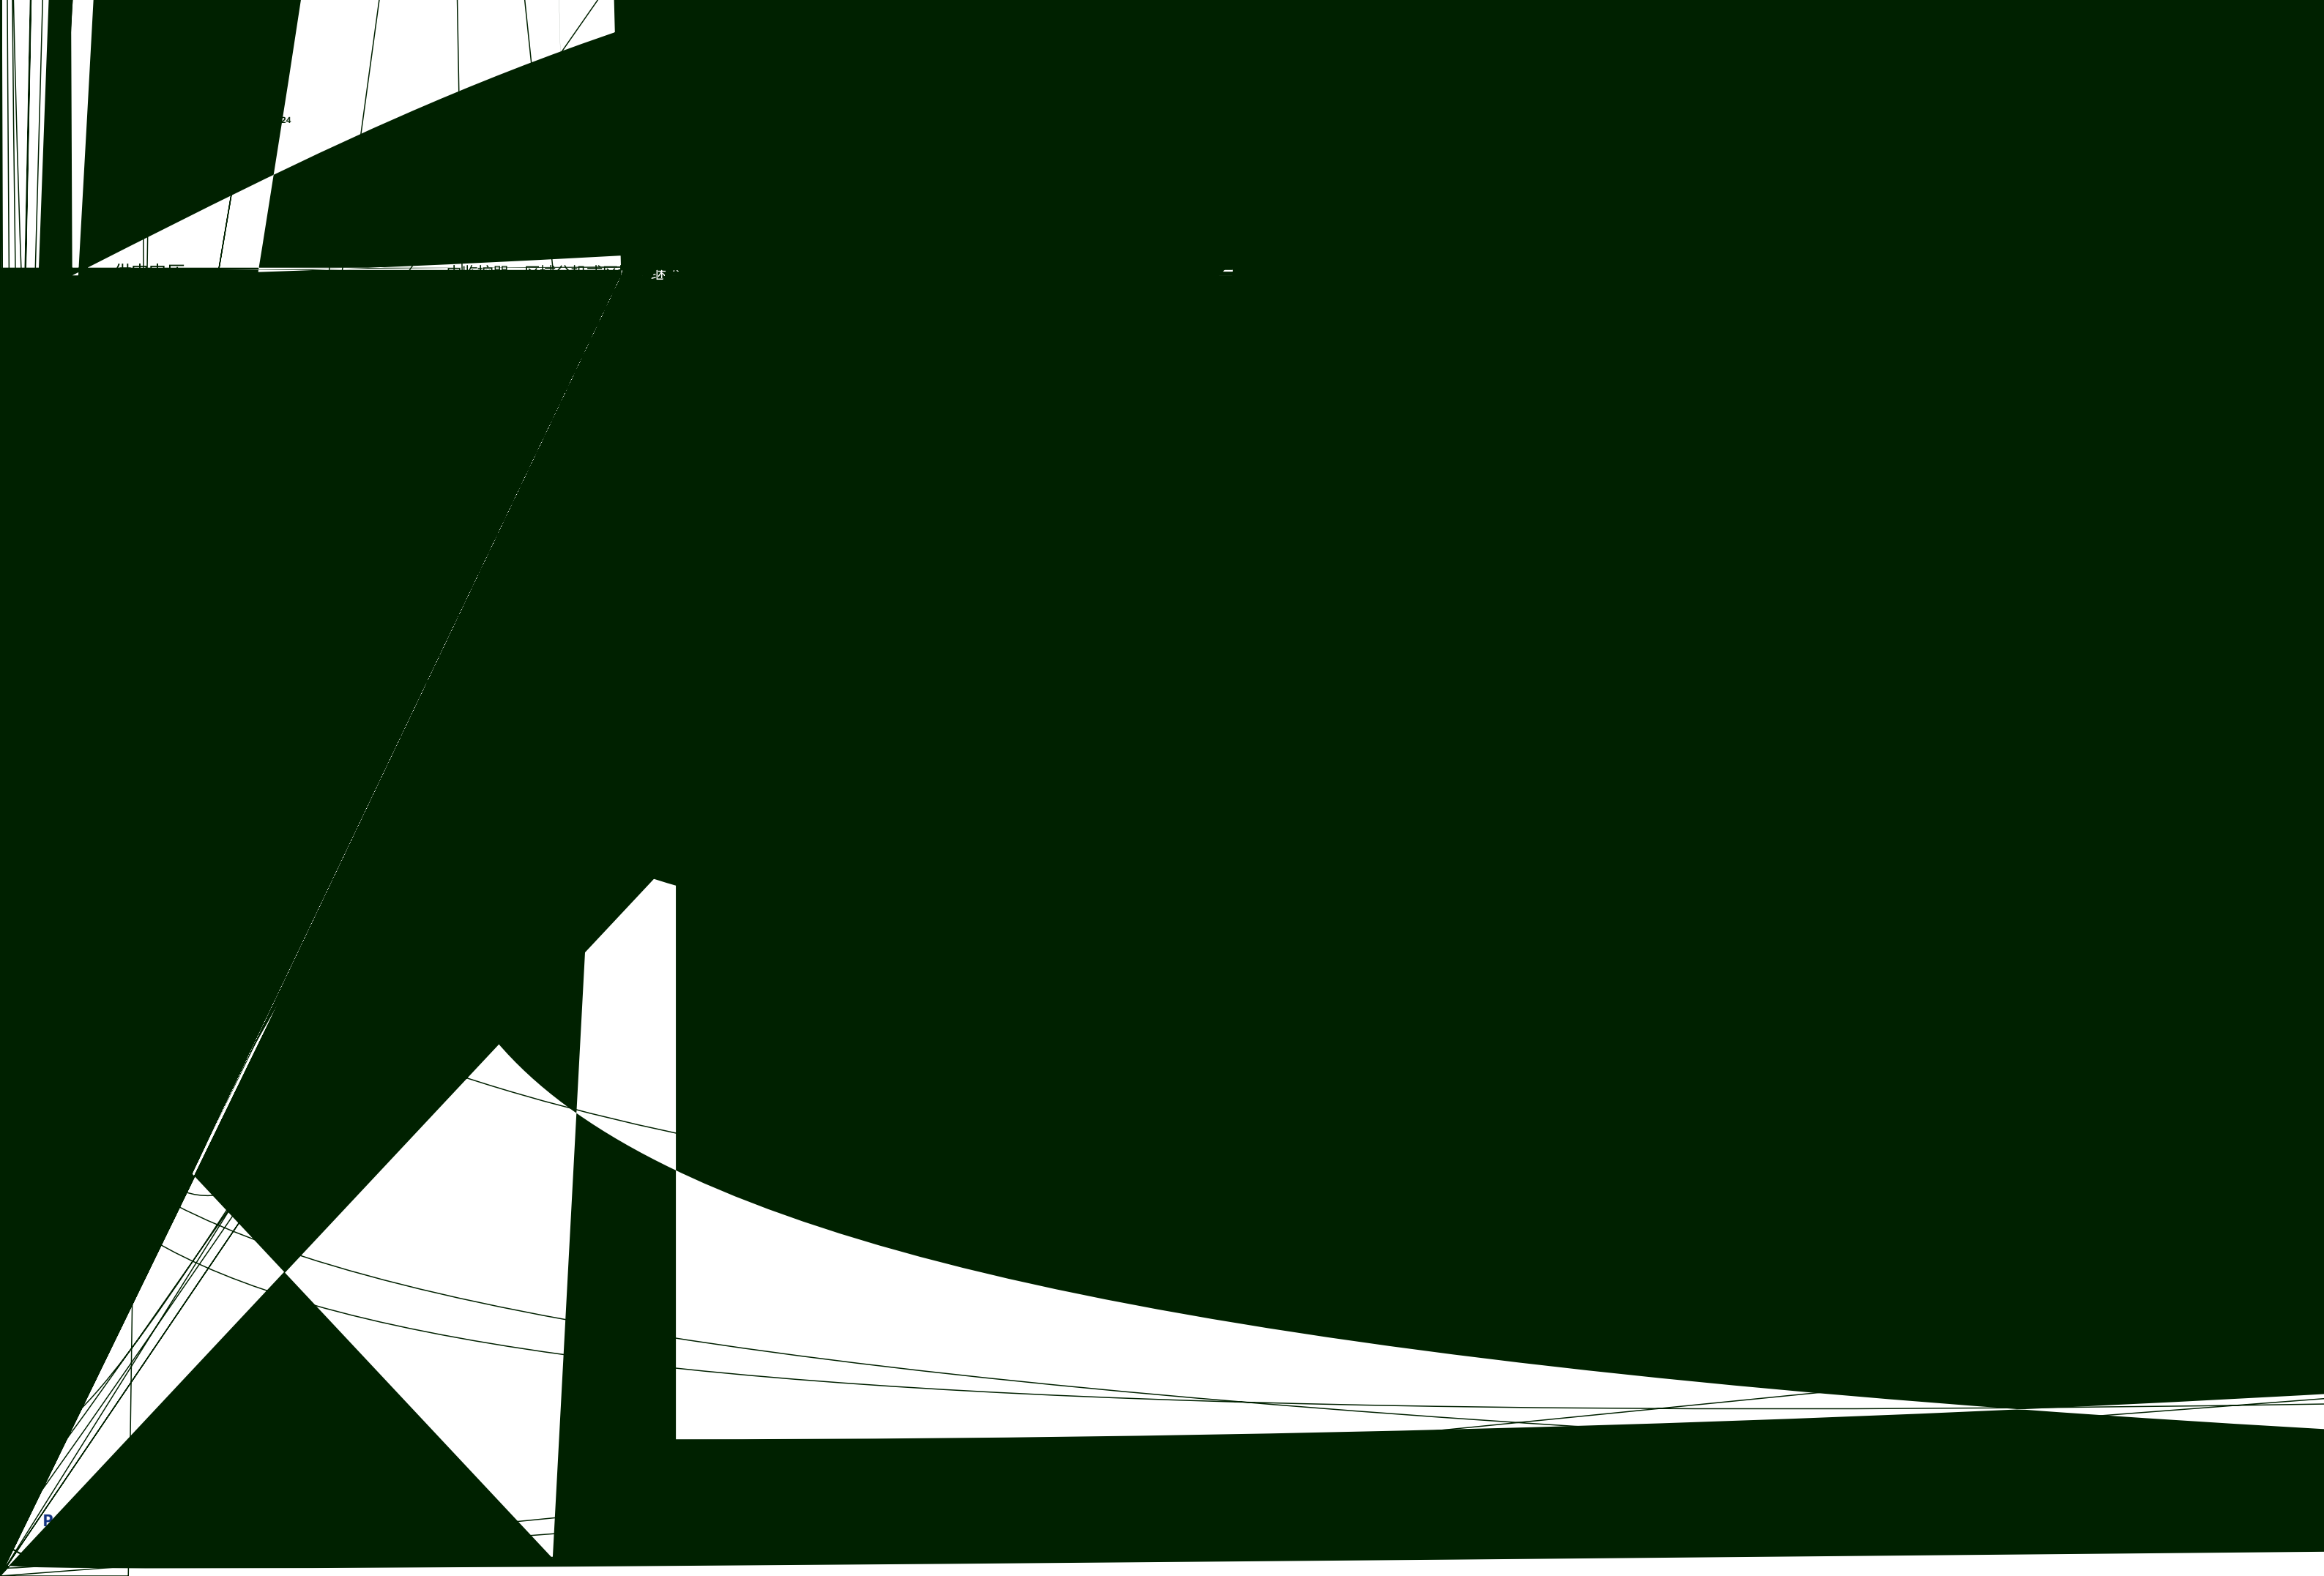


24

10

10

完全满足国标GB28184-2011《消防设备电源监控系统》的要求；



产品特点

- GB28184-2011
-
-
-
- DC24V
- D: 24M2011--2011--2011--2011-
-


-2011

电压/电流信号传感器

		100: 5	1 ZT-T
		100: 5	1 ZT-T
	-P	100: 5	3 ZT-T
	ZGI-P2A	100: 5	3 ZT-T

产品特点

- GB28184-2011
-
- 3m ZR-BV-2x1.0mm²
- 0A 1000A

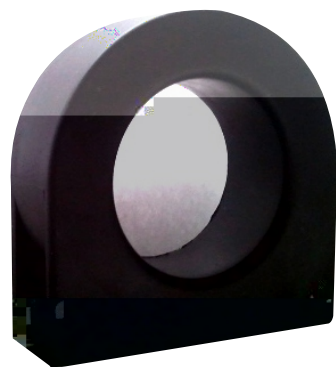

产品

-
-
-
-
-

